



**THE DATASHEET OF  
CRM-111H/UNI**



# CRM-111H, CRM-112H, CRM-113H | Multifunction time relay with inhibit delay



EAN code  
 CRM-111H/UNI: 8595188175548  
 CRM-112H/UNI: 8595188175531  
 CRM-113H/UNI: 8595188180634

## Technical parameters CRM-111H CRM-112H CRM-113H

### Power supply

Supply terminals:	A1-A2		
Supply voltage:	AC/DC 12 - 240 V (AC 50/60 Hz)		
Consumption (max.):	2 VA/1.5 W	2.5 VA/1.5 W	2.5 VA/1.5 W
Supply voltage tolerance:	-15 %; +10 %		
Supply indication:	green LED		

### Time circuit

Number of functions:	11	10	10
Time ranges:	50 ms – 30 days		
Time setting:	rotary switches and potentiometers		
Time deviation*:	5 % – mechanical setting		
Repeat accuracy:	0.2 % – set value stability		
Temperature coefficient:	0.01 %/°C, at = 20 °C (0.01 %/°F, at = 68 °F)		

### Output

Contact type 1:	1x changeover/SPDT (AgNi)		
Current rating:	16 A/AC1; PD. B300		
Breaking capacity:	4000 VA/AC1, 384 W/DC1		
Electrical life (AC1):	100.000 ops.		
Contact type 2 (3):	x	1x chang./SPDT (AgNi)	2x chang./DPDT (AgNi)
Current rating:	x	16 A/AC1; PD. B300	8 A/AC1; PD. B300
Breaking capacity:	x	4000 VA/AC1, 384 W/DC1	2000 VA/AC1, 192 W/DC1
Electrical life (AC1):	x	100.000 ops.	50.000 ops.
Switching voltage:	250V AC/24 V DC		
Power dissipation (max.):	1.2 W	2.4 W	2.4 W
Output indication:	multifunction red LED		
Mechanical life:	10.000.000 ops.		

### Control


Control terminals:	A1-S		
Load between S-A2:	Yes		
Impulse length:	min. 25 ms/max. unlimited		
Reset time:	max. 150 ms		

### Other information


Operating temperature:	-20 .. +55 °C (-4 .. 131 °F)		
Storage temperature:	-30 .. +70 °C (-22 .. 158 °F)		
Dielectric strength:			
supply – output 1	AC 4 kV		
supply – output 2 (3)	x	AC 4 kV	AC 1 kV
output 1 – output 2	x	AC 4 kV	AC 1 kV
output 2 – output 3	x	x	AC 1 kV
Operating position:	any		
Mounting:	DIN rail EN 60715		
Protection degree:	IP40 front panel/IP20 terminals		
Overvoltage category:	III.		
Pollution degree:	2		
Cross-wire section – solid/stranded with ferrule (mm <sup>2</sup> ):	max. 1x 2.5 or 2x 1.5/ max. 1x 2.5 (AWG 12)		
Dimensions:	90 x 17.6 x 64 mm (3.5" x 0.7" x 2.5")		
Weight:	62 g (2.2 oz.)	85 g (3 oz.)	85 g (3 oz.)
Standards:	EN 61812-1		

- Multifunction time relay for universal use in automation, control and regulation or in house installations.
- All functions initiated by the supply voltage, except for the flasher function, can use the control input to inhibit the delay (pause).
- Mode selection - according to the set function, permanently closed, permanently open, function of MEMORY LATCH with delay (CRM-111H)/switching of the second output contact according to supply voltage (CRM-113H).
- Multifunction red LED flashes or shines depending on the operating status.

## Description

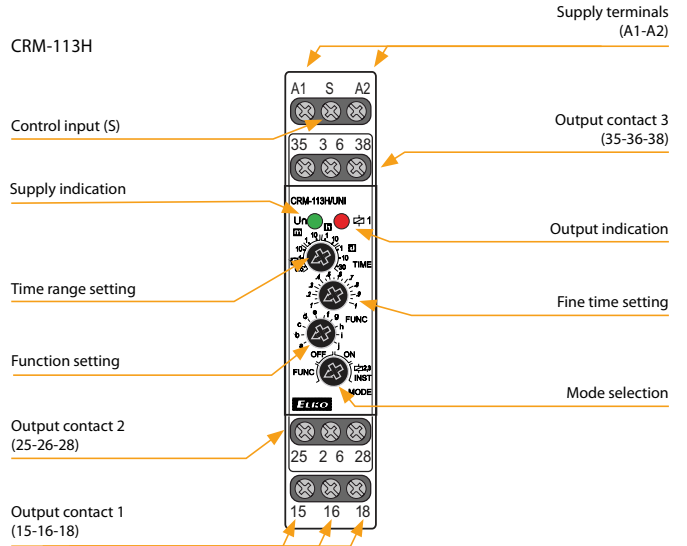


## Connection

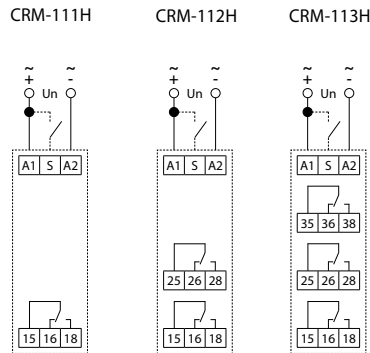

**CRM-113H:**  
 The potential difference between the supply terminals (A1-A2), output contact 2 (25-26-28) and output contact 3 (35-36-38) must be a maximum of 250 V AC rms/DC.



## Possibility to connect load onto controlling input

It is possible to connect the load (e.g.: contactor) between terminals S-A2, without any interruption of correct relay function.



\* for adjustable delay <100 ms, a time deviation of ± 10 ms applies

## Indication of operating states

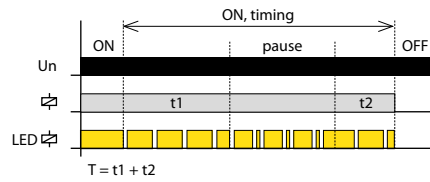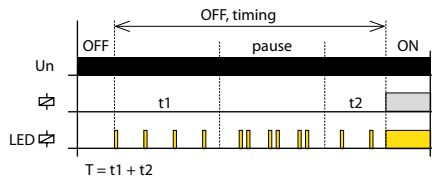

## Mode selection

### FUNC. Settings function mode

The desired function a-j is set with the FUNC rotary switch.

### OFF. Output contact open mode



### ON. Output contact closed mode



### Function: MEMORY LATCH with delay (Only for CRM-111H)



When the supply voltage is applied, the relay is open. If the control contact is closed, the relay closes and the time delay  $T$  starts. It does not matter the length of the control pulse. When the timing is complete, the relay opens. If the control contact is closed during timing, the relay opens immediately. Each time the control contact closes during relay timing, it changes status.

### 2,3 INST. Second or third output contact instantaneous (Only for CRM-112H, CRM-113H)



The second or third output contact switches according to the supply voltage. The first output contact switches according to the function (a-j) set by the trimmer FUNC.

## Function

Function (page 17).


## Function

### a. ON DELAY



When the supply voltage is applied, the time delay T begins. When the timing is complete, the relay closes and this condition continues until the supply voltage is disconnected.

#### ON DELAY with Inhibit




If the control contact is closed and the supply voltage is connected, the relay is opened and timing does not start until the control contact opens. When the timing is complete, the relay closes. If the control contact is closed during timing, the timing is interrupted and continues only after the control contact opens.

### b. INTERVAL ON



After supply voltage relay closes and starts the delay time T. After the end of the timing relay opens and this state lasts until the supply voltage is disconnected.

#### INTERVAL ON with Inhibit




If the control contact is closed and the supply voltage is connected, the relay will close and the timing will start only after the control contact has been opened. When the timing is complete, the relay opens. If the control contact is closed during timing, the timing is interrupted and continues only after the control contact opens.

### c. FLASHER - ON first



After supply voltage relay closes and starts the delay time T. After the end of the timing relay opens and again runs delay time T. When the timing is complete, the relay closes again and the sequence is repeated until the supply voltage is disconnected. If the control contact is closed during timing, this does not affect the operation of the cyclers.

#### FLASHER - OFF first



If the control contact is closed during timing; this does not affect the operation of the cyclers. If the control contact is closed and the supply voltage is connected, the cyclers starts with a pause (relay open).

### d. MEMORY LATCH




When the supply voltage is applied, the relay is open. When the control contact is closed, the relay closes. The status does not change when the control contact is opened. When the control contact is closed again, the relay opens. Each time the control contact is closed, the relay changes status.

### e. OFF DELAY




When the supply voltage is applied, the relay is open. When the control contact is closed, the relay closes. When the control contact opens, the time delay T begins. If the control contact is closed during timing, the time is reset and the relay remains closed. When the control contact opens, the time delay T starts again and opens when the relay closes.

### f. SINGLE SHOT




When the supply voltage is applied, the relay is open. When the control contact is closed, the relay closes and the time delay T begins. Closing the control contact during timing is ignored.

### g. WATCHDOG




When the supply voltage is applied, the relay is open. When the control contact is closed, the relay closes and the time delay T begins. Closing the control contact during timing triggers a new time delay T - the relay closing time is thus increased.

### h. PULSE GENERATOR 0.5 s




After the supply voltage has been applied, the time delay T begins. When the timing is complete, the relay closes for a fixed time (0.5 s).

#### PULSE GENERATOR 0.5 s with Inhibit




After supply voltage starts the time delay T. By closing timing of the control contact during timing is suspended. When the control contact opens, the time interval is completed and the relay closes for a fixed time (0.5 s).

### i. INTERVAL ON/OFF

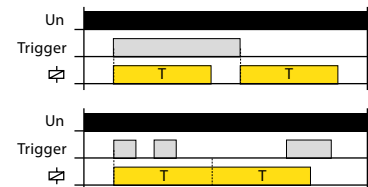

When the supply voltage is applied, the relay is open. When the control contact is closed, the relay closes and the time delay T begins. When the control contact is opened, the relay closes and the time delay T begins. If the control contact is open during timing, the relay remains closed for 2T. When the timing is complete, the relay opens. Any other change of control contact status during timing is ignored.

### j. ON/OFF DELAY

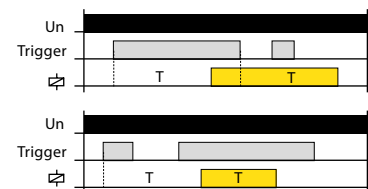

When the supply voltage is applied, the relay is open. If control contact is closed, time delay T starts. When the control contact is opened, a new time delay T begins. If the control contact is open during timing, the relay closes at the end of the timing and opens the relay after the new time delay. Any other change of control contact status during timing is ignored.

## Looking for pricing, stock, or lifecycle information?

Click below to explore more details on WIN SOURCE:

- ⊖ [View CRM-111H/UNI on WIN SOURCE](#)
- ⊖ [ELKO EP North America LLC Information](#)

## Optimize Your Supply Chain with WIN SOURCE Solutions

- ✓ Global Sourcing Solution
- ✓ Obsolete Management
- ✓ Cost Control Management
- ✓ Shortage Management
- ✓ Alternative Solution
- ✓ Excess Inventory Management